

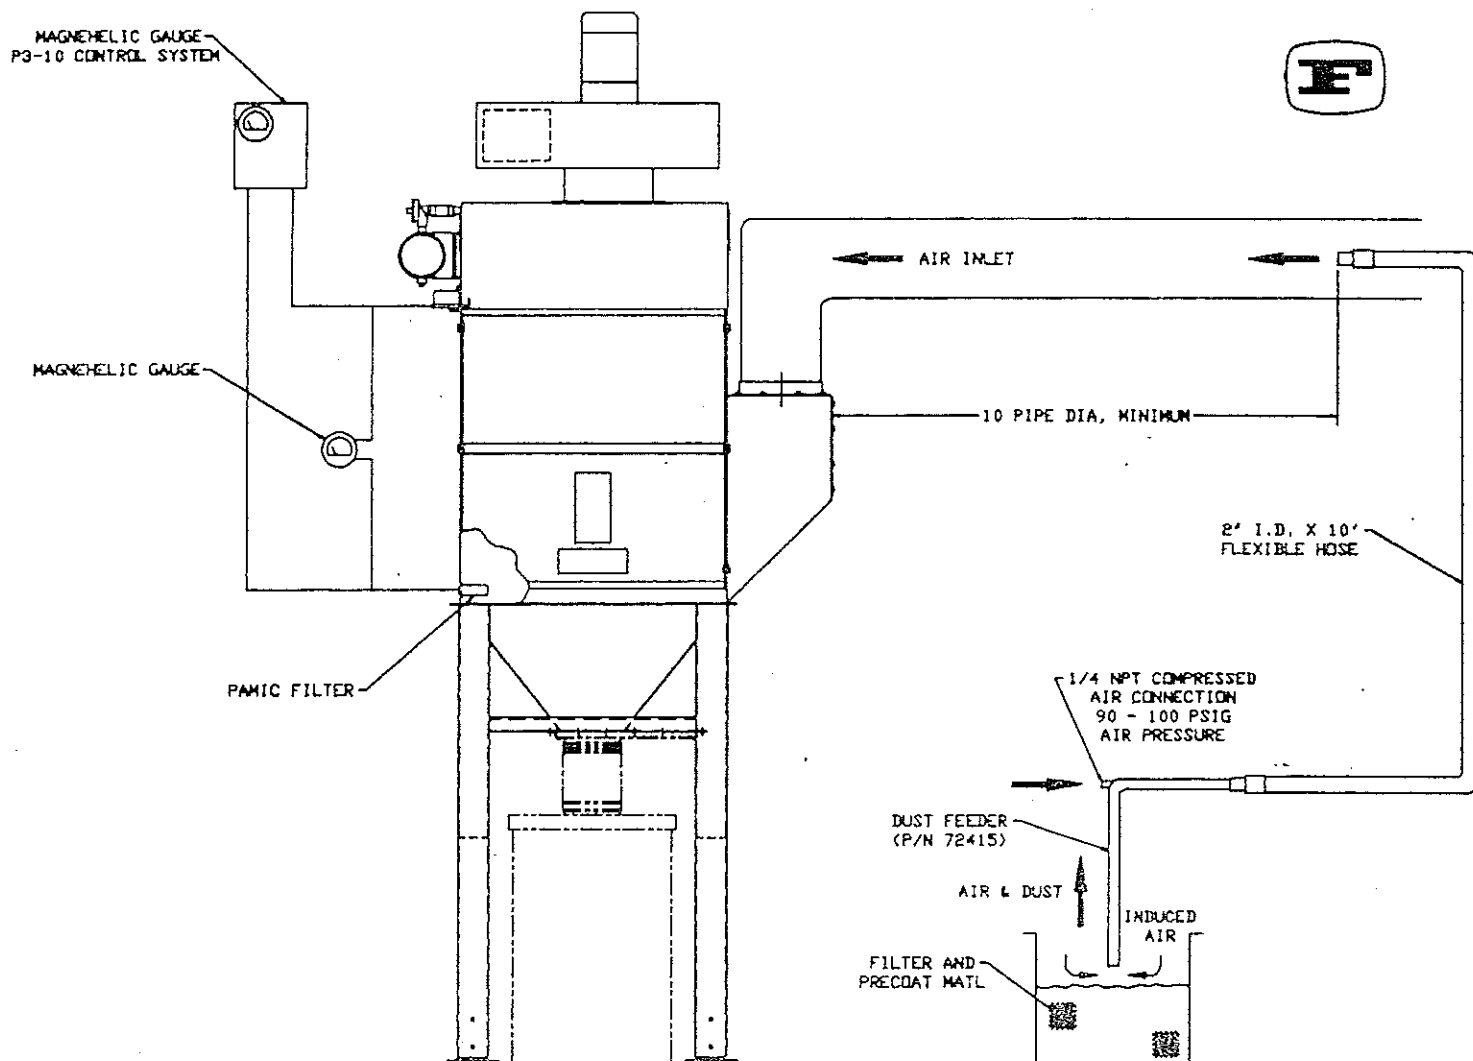


Figure 2.13

Table 1

Unit Size	$\Delta P^{(1)}$ (Inch w.g.)	Precoat ⁽²⁾ Airflow (Cfm)	Approximate Precoat Feed Rate (# / min.)	Precoat Amount (Lbs.)	Approximate Feed Time (Minutes)	Off Time Setting On Control Board (Seconds)
2C	0.4	800	0.40	12	30	90
3C	0.4	1200	0.65	20	30	60
4D	0.4	1600	0.85	25	30	50
5C	0.4	2000	1.00	30	30	40
6D	0.4	2400	1.25	35	30	30
8D	0.4	3200	1.25	50	40	30
10D	0.4	4000	1.25	60	50	30
12D	0.4	4800	1.25	70	60	30
16D	0.4	6400	1.50	100	70	30
20D	0.4	8000	1.50	120	80	30
24D	0.4	9600	1.50	140	90	30
32D	0.4	12800	1.50	200	130	30

(1) Photohelic or magnehelic gage reading.

(2) 400 cfm per filter element.


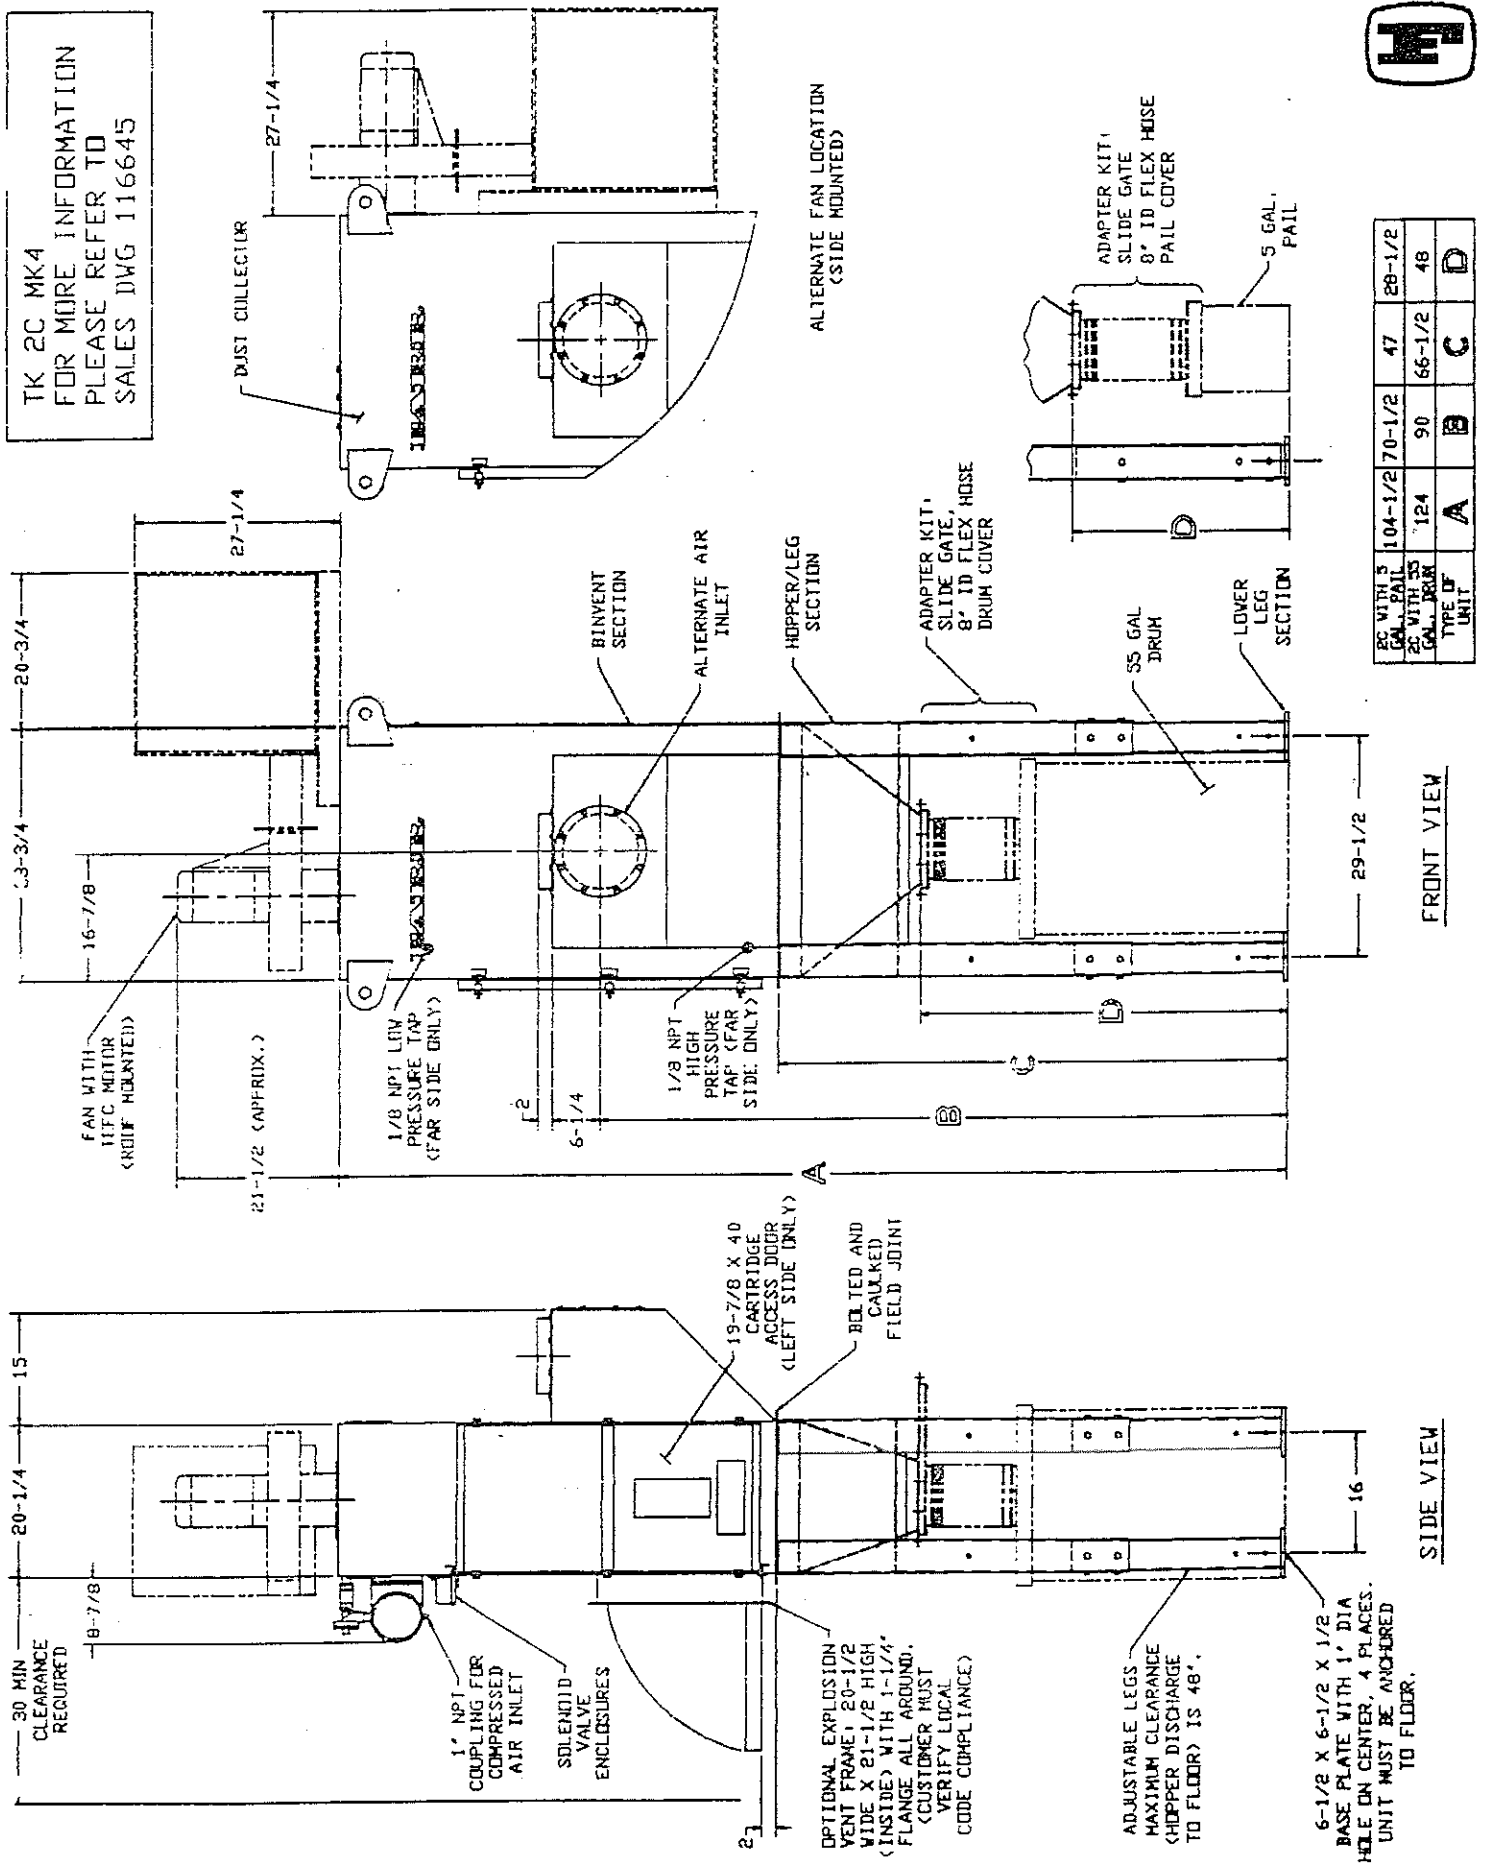


FIGURE 7.1.1

TK 3C MK4
FOR MORE INFORMATION
PLEASE REFER TO
SALES DWG 116646

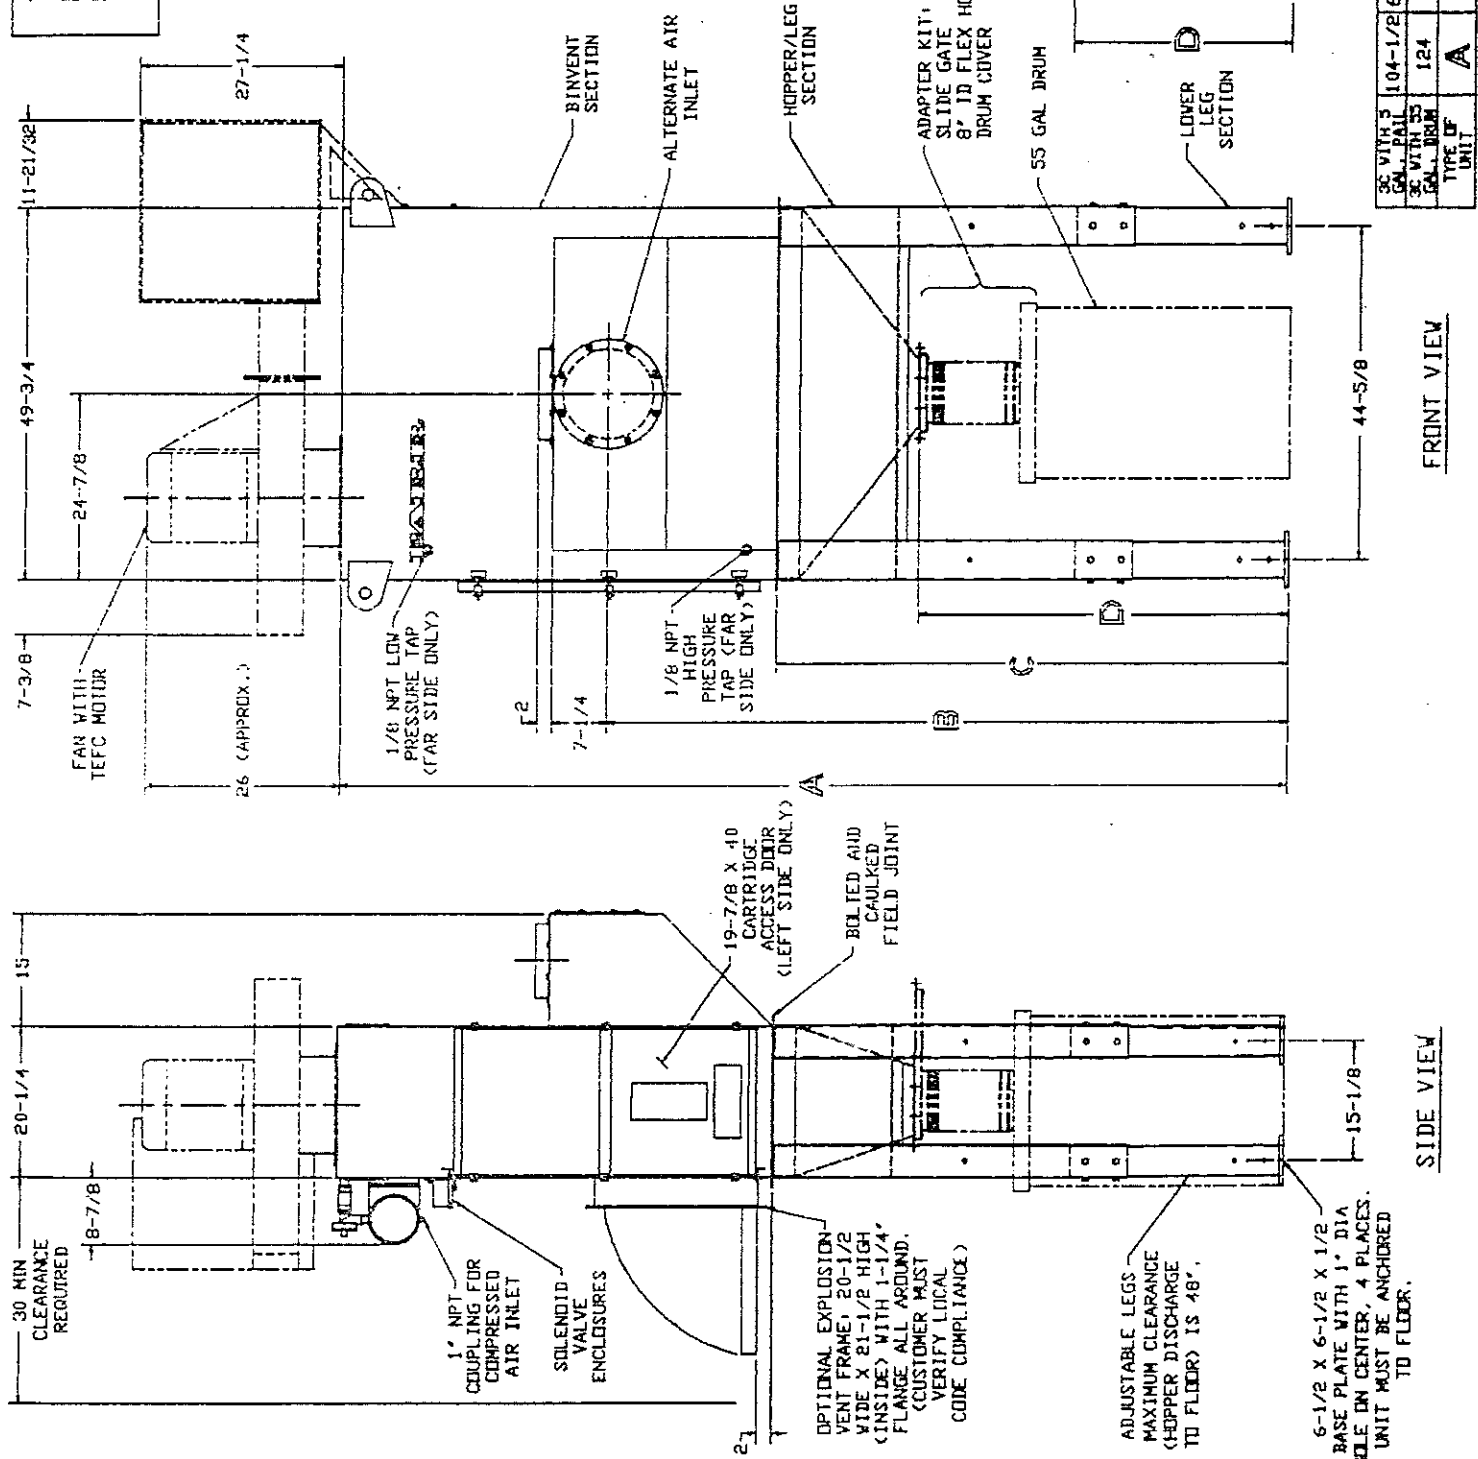

3C WITH 3 GAL PAUL	104-1/2	69-1/2	47	28-1/2
3C WITH 55 GAL DRUM	124	89	66-1/2	48
TYPE OF UNIT	A	B	C	D

FIGURE 7.18



MODEL NUMBER	NUMBER OF CARTRIDGES	CARTRIDGE SURFACE AREA SQ. FT.	NUMBER OF AIR VALVES	DIMENSIONS															INLET OPENING SIZE	ESTIMATED WEIGHT
				A	B	C	D	E	F	G	H	J	K	L	M	N	P			
2C	2	600	2	33-3/4	16-7/8	6-1/4	23-1/2	6-3/16	6	33-1/2	8	32	28	10-1/8	11-1/4	6-3/4	8-3/4	10 O.D.	715 #	
3C	3	900	3	49-3/4	24-7/8	7-1/4	22-1/2	7-1/4	8-1/8	49-1/2	12	48	36	10-1/2	11	12-3/4	14-3/4	12 O.D.	900 #	
5C	5	1500	5	81-3/4	40-7/8	7-1/4	22-1/2	7-1/4	8-1/8	81-1/2	20	80	52	9-1/2	14	12-3/4	14-3/4	12 X 18	1230 #	

BIN VENT 2C, 3C & 5C MK4
WITH INLET PLENUM
FOR MORE INFORMATION
PLEASE REFER TO
SALES DWG 116822

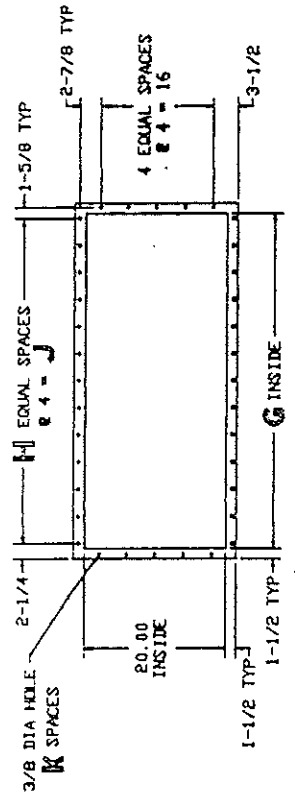
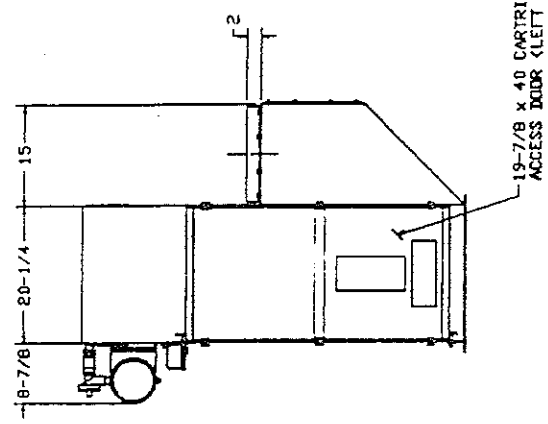
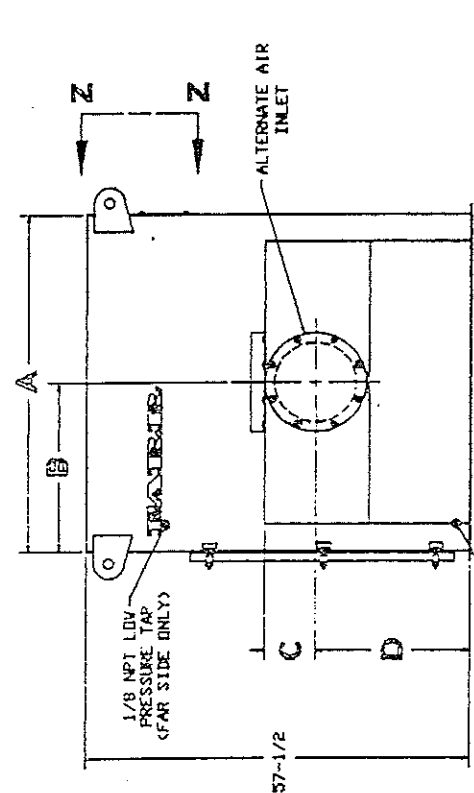

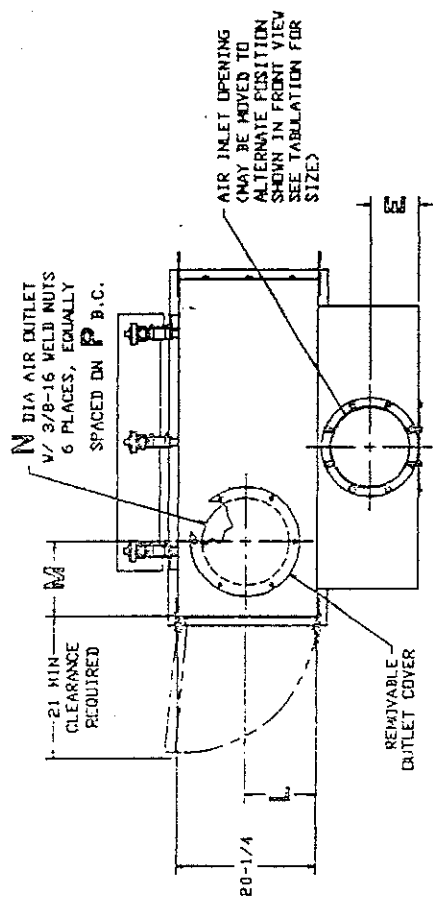


FIGURE 7.3